

PLUG-IN-SYSTEMS LTD

MAINS UNIT CEC 225

- The MCB's (Minature Circuit Breakers) are better described as mechanical fuses, which in the event of an overload situation in the circuit which they supply will automatically switch to the OFF position. After elimination of the fault the MCB is re-set by switching back on again (against the spring pressure) in an upwards direction.
- In normal operation these MCB's should be left in the ON position. The residual current device (RCD) is fitted to provide protection against earth faults and possible electrical shock. In the event of an earth fault causing a leak of current to earth, either directly or via the human body, the unit should immediately trip, and switch OFF the supply. Only after elimination of the fault will it be possible to re-set the RCD to the ON position and so restore the supply again. The ON position is upwards against the spring pressure.
- Periodically it is necessary to test the operation of the RCD. This is achieved by ensuring that it is in the switched ON position with an electricity supply connected. By pressing the test button marked 'T' the unit should immediately switch to the OFF position. Provided this happens all is correct and the switch should be returned to the ON position (upwards) to restore the supply back to normal.
- The RCD also acts as the main switch for the unit and, if it is required to switch off all circuits in the caravan, this is done by operating the OFF/ ON switch on the RCD.

CEC PLUG-IN-SYSTEMS LIMITED

Willerby, Hull, HU10 6EQ Telephone:
0482 652523 Fax: 0482 650635

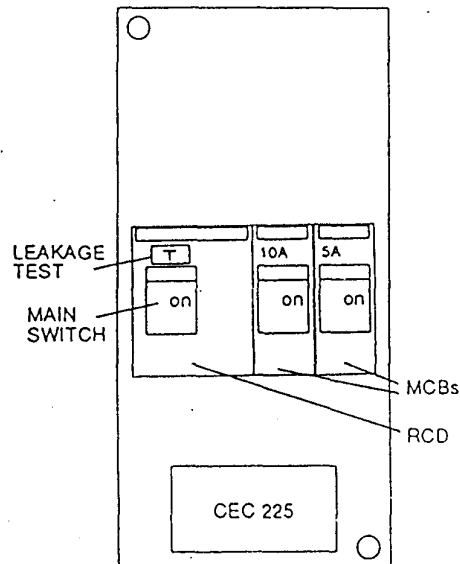


FIG. 2 CEC 225